



Department of Community Affairs
Construction Project Review
Project No.: 5228-22
Partial Release Interior Building
BUILDING
Albert Monte
Released: 02/21/23
N.J.S.A. 52:27D-119 ET SEQ., AS AMENDED

POSEN ARCHITECTS, LLC

Architecture • Interiors • Planning • Regulatory Approvals

NJ:
25 Columbia Street
West Orange, NJ 07052
T: 973-325-3250

NY:
222 Mamaroneck Avenue
White Plains, NY 10605
T: 914-935-8820

Posen Architects, LLC
NY Cert. 80883
NJ Cert. 21AC00035700

Dennis A. Posen, AIA
NY Lic. 015028-1
NJ 21AI00808700

Kosta Koulouris, AIA
NY Lic. 034846-1
NJ 21AI01893200

Thomas A. Fantiaccone, AIA
NY Lic. 035897-1
NJ 21AI00792500

William S. Hamilton, AIA
NY Lic. 030718-1
NJ 21AI01380200


www.posen.com
Copyright © 2022

Issuance / Revision		
No.	Date	Description


Structural Consultant: Jeff Ling, PE
Email: jling@cacengineers.com; T: 908-298-1600
CEC Engineers, 730 Boulevard, Kenilworth, NJ 07033

MEP/FP Consultant: David Arabia, PE
Email: darabia@kugroup.com; T: 201-791-1210
LKU Engineers, 241 Molnar Drive, Elmwood Park, NJ 07407

Client:
CAREPOINT HEALTH - CHRIST HOSPITAL 29 EAST 29TH STREET BAYONNE, NJ 07002
Project:
CATH LAB #2 - SUITE EXPANSION 176 PALISADE AVENUE JERSEY CITY, NJ 07306



Posen Project No.: DCA Number: 22119 NJPRP-14794		
Submission: ISSUED FOR CONSTRUCTION		
Drawing: CEILING DETAILS		
Drawn By:	Checked By:	Date: 8/10/2022
Scale: 1 1/2" = 1'-0"	Dwg No./Issue No.: A-710.	Drawing: 31 of



RECESSED FIXTURE MAY BE SUPPORTED BY MAIN "T" SPACED 2'-0" OR 4'-0" OC

#10 GALVANIZED WIRE HANGERS NOT TO EXCEED 4'-6" OC, MAX.

CROSS "T"

MAIN RUNNER "T"


LAY IN TILES PER PLAN AND SCHEDULE.

- GENERAL NOTES:**
- REFER TO FINISH SCHEDULE A-160 FOR CEILING INFORMATION.
 - AT EACH END OF LIGHT FIXTURE, AN INTERLOCKING CROSS "T" OR LOCKING BAR MUST BE USED.
 - THE TOTAL WEIGHT OF LIGHT FIXTURE AND OTHER EQUIPMENT SUPPORTED BY THE MAIN BEAM MUST NOT EXCEED THE ALLOWABLE DEFLECTION OF L/360 OF ITS SPAN. DEFLECTION DATA MUST BE FURNISHED AND CERTIFIED BY THE MANUFACTURER.
 - FIXTURES EXCEEDING 80 LBS SHALL BE SUPPORTED INDEPENDENT OF THE CEILING SUSPENSION SYSTEM.
 - FIXTURES WEIGHING 80 LBS OR LESS MAY BE SUPPORTED FROM THE CEILING CARRYING CHANNELS.
 - FIXTURES WEIGHING 50 LBS OR LESS MAY BE SUPPORTED BY THE MAIN RUNNERS ONLY. CROSS MEMBERS SHALL NOT BE USED.
 - SURFACE OR PENDANT FIXTURES MUST BE INDEPENDENTLY SUPPORTED FROM 1 1/2" BLACK IRON OR FROM FLOOR / ROOF CONSTRUCTION. SEE NOTE 3 FOR WEIGHT LIMITATIONS.
 - SYSTEM TO COMPLY WITH NJ BUILDING CODE - SECTION 808 - ACOUSTICAL CEILING SYSTEMS.

- CEILING SEISMIC NOTES:**
- WHERE CEILINGS ARE 144 SF OR GREATER, THEY SHALL BE SUPPORTED AS FOLLOWS:
 - THE CEILING SHALL BE SUPPORTED FROM THE STRUCTURE ABOVE TO PROVIDE A "FREE-FLOATING" SYSTEM TO WITHSTAND BUILDING MOTIONS CAUSED BY SEISMIC DISTURBANCE. MAIN AND CROSS TEES SHALL NOT HAVE A POSITIVE CONNECTION TO WALL ANGLES BUT SHALL BE ALLOWED TO HAVE FREE MOVEMENT.
 - INDIVIDUAL FIXTURES AND ATTACHMENTS WITH A COMBINED WEIGHT OF 10 LBS SHALL HAVE (1) #12 GA WIRE HANGERS CONNECTED TO THE STRUCTURE ABOVE. THIS WIRE MAY BE SLACK.
 - INDIVIDUAL FIXTURES AND ATTACHMENTS WITH A COMBINE WEIGHT BETWEEN 11LBS AND 26LBS HAVE TWO (2) #12 GA WIRE HANGERS CONNECTED TO THE STRUCTURE ABOVE AT DIAGONAL CORNERS. THIS WIRE MAY BE SLACK.
 - INDIVIDUAL FIXTURES AND ATTACHMENTS WITH A COMBINED WEIGHT GREATER THAN 56 LBS SHALL BE INDEPENDENTLY SUPPORTED FROM THE STRUCTURE ABOVE.

DETAIL STANDARD HUNG CEILING


1 1/2" = 1'-0"



- TYPICAL NOTES:**
- ALL ACT CEILINGS TO BE ANCHORED TO VERTICAL SURFACES WITH THIS DETAIL UNLESS NOTED OTHERWISE.
 - GC TO VERIFY EXISTING STRUCTURE AND ATTACHMENT METHOD.
 - REFER TO DETAIL 1 THIS SHEET FOR ALL CEILING CONSTRUCTION REQUIREMENTS AND NOTES

DETAIL AT HUNG CEILING (TYP.)


1 1/2" = 1'-0"



- TYPICAL NOTES:**
- ALL ACT CEILINGS TO BE ANCHORED TO VERTICAL SURFACES WITH THIS DETAIL UNLESS NOTED OTHERWISE.
 - GC TO VERIFY EXISTING STRUCTURE AND ATTACHMENT METHOD.
 - REFER TO DETAIL 1 THIS SHEET FOR ALL CEILING CONSTRUCTION REQUIREMENTS AND NOTES


DETAIL AT GWB CEILING (TYP.)

1 1/2" = 1'-0"



DETAIL AT ACT FLUSH SOFFIT


1 1/2" = 1'-0"



- NOTES:**
- REFER TO DETAIL 1 THIS SHEET FOR ALL CEILING CONSTRUCTION REQUIREMENTS AND NOTES.
 - PROVIDE ADDITIONAL VERTICAL RUN OF STUD SUPPORT TO STRUCTURE ABOVE @ 4'-0" OC (MAX) AS NEEDED (VIF).

DETAIL FLUSH GYPSUM BOARD AND ACT


1 1/2" = 1'-0"



- NOTES:**
- REFER TO DETAIL 1 THIS SHEET FOR ALL CEILING CONSTRUCTION REQUIREMENTS AND NOTES.
 - PROVIDE ADDITIONAL VERTICAL RUN OF STUD SUPPORT TO STRUCTURE ABOVE @ 4'-0" OC (MAX) AS NEEDED (VIF).

DETAIL AT ACT TO SOFFIT AT WALL


1 1/2" = 1'-0"

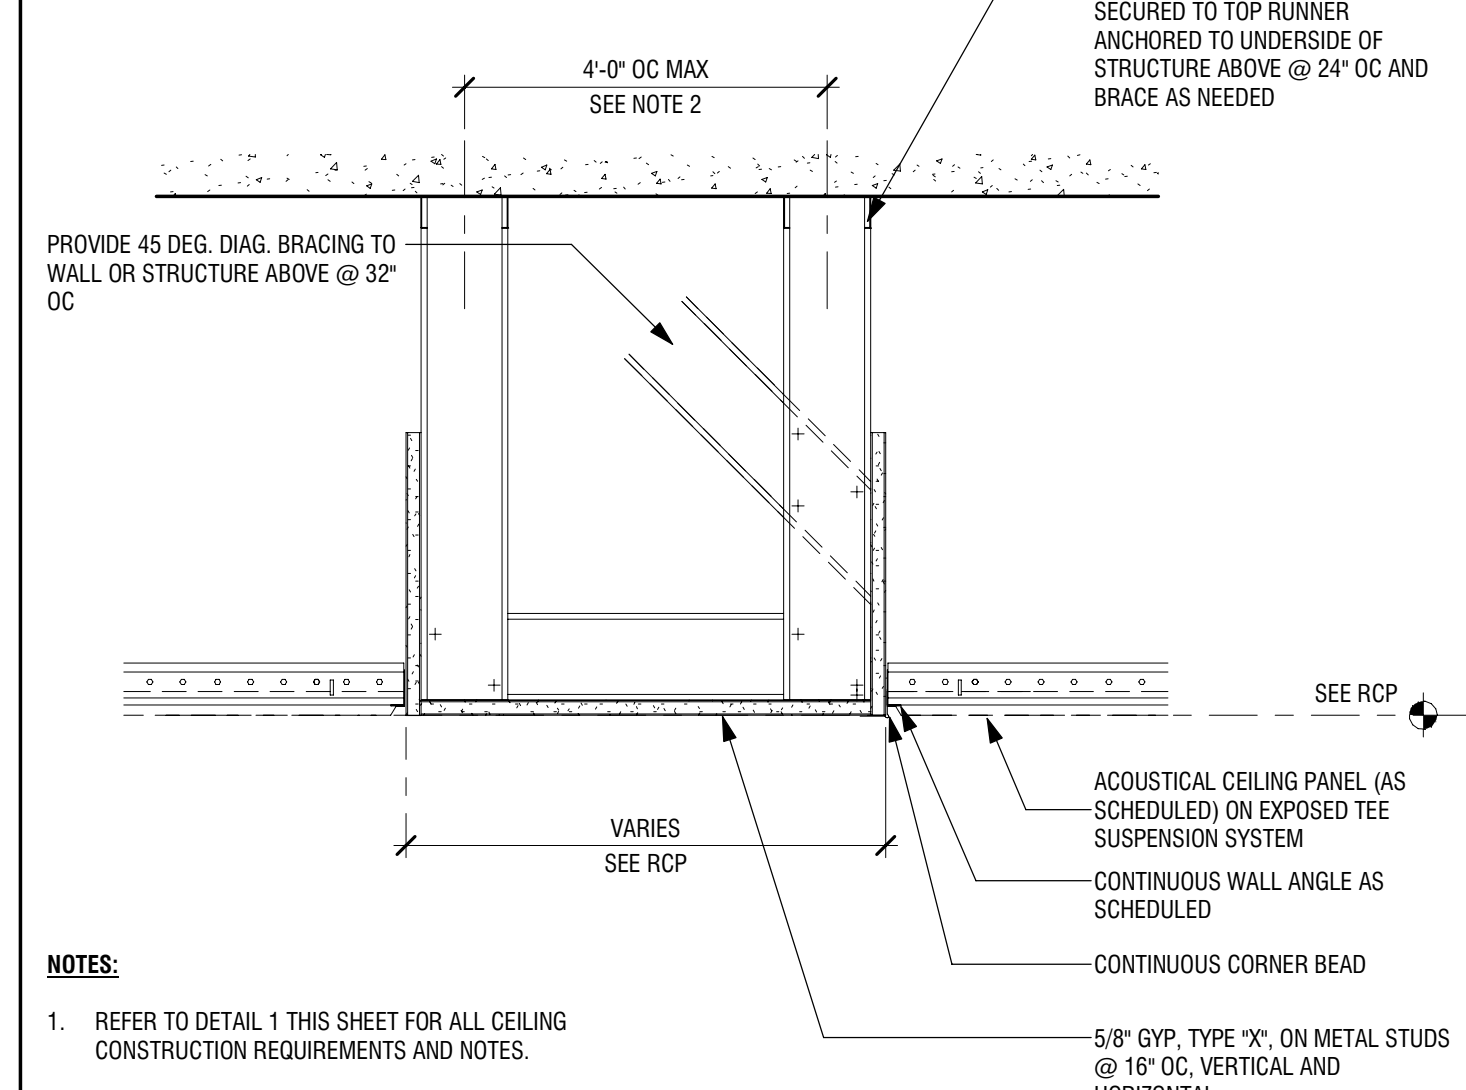

- NOTES:**
- REFER TO DETAIL 1 THIS SHEET FOR ALL CEILING CONSTRUCTION REQUIREMENTS AND NOTES.
 - PROVIDE ADDITIONAL VERTICAL RUN OF STUD SUPPORT TO STRUCTURE ABOVE @ 4'-0" OC (MAX) AS NEEDED (VIF).
 - PROVIDE DIAG. BRACING ON BOTH SIDES WHERE SOFFIT WIDTH IS GREATER THAN 24".

DETAIL AT ACT FLUSH SOFFIT

1 1/2" = 1'-0"



- NOTES:**
- REFER TO DETAIL 1 THIS SHEET FOR ALL CEILING CONSTRUCTION REQUIREMENTS AND NOTES.
 - PROVIDE ADDITIONAL VERTICAL RUN OF STUD SUPPORT TO STRUCTURE ABOVE @ 4'-0" OC (MAX) AS NEEDED (VIF).
 - PROVIDE DIAG. BRACING ON BOTH SIDES WHERE SOFFIT WIDTH IS GREATER THAN 24".

DETAIL AT ACT DROP SOFFIT

1 1/2" = 1'-0"